



PRECAST CONC. SLAB

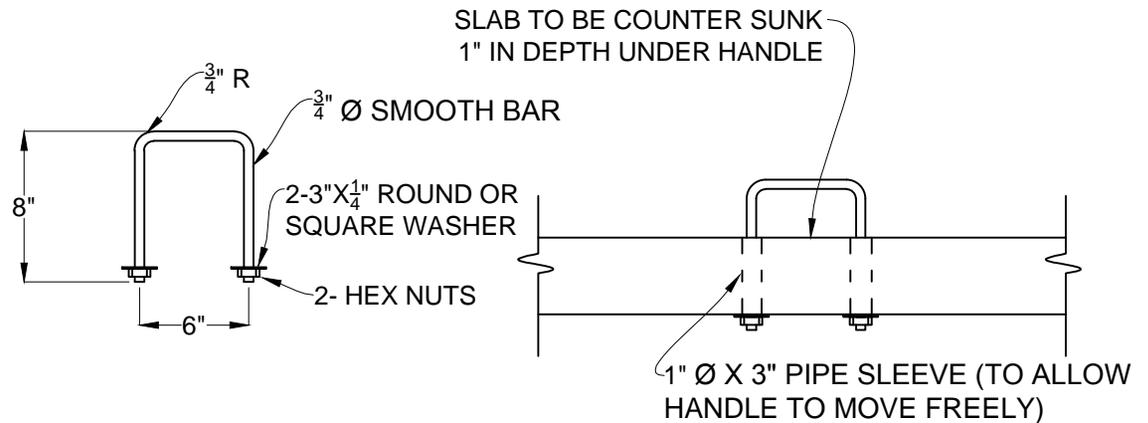


HANDLE DETAIL

NOTES:

1. EITHER SOLID BLOCK OR PRECAST CONCRETE MAY BE USED.
2. CAST IN PLACE DESIGNS TO BE SUBMITTED.
3. CONCRETE WALLS TO BE 6" THICK MIN.
4. STEPS REQUIRED AT 16" O.C. THROUGHOUT, WHERE DEPTH EXCEEDS 5'.
5. USE ONLY 3000 PSI CONCRETE MIX.
6. INSIDE DIMENSION FOR 24" PIPE AND UP, USE PIPE DIAMETER PLUS 12".

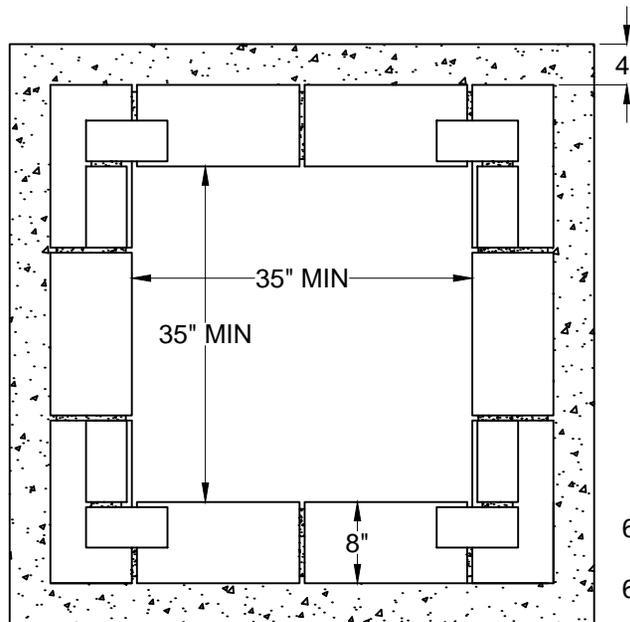

PLAN

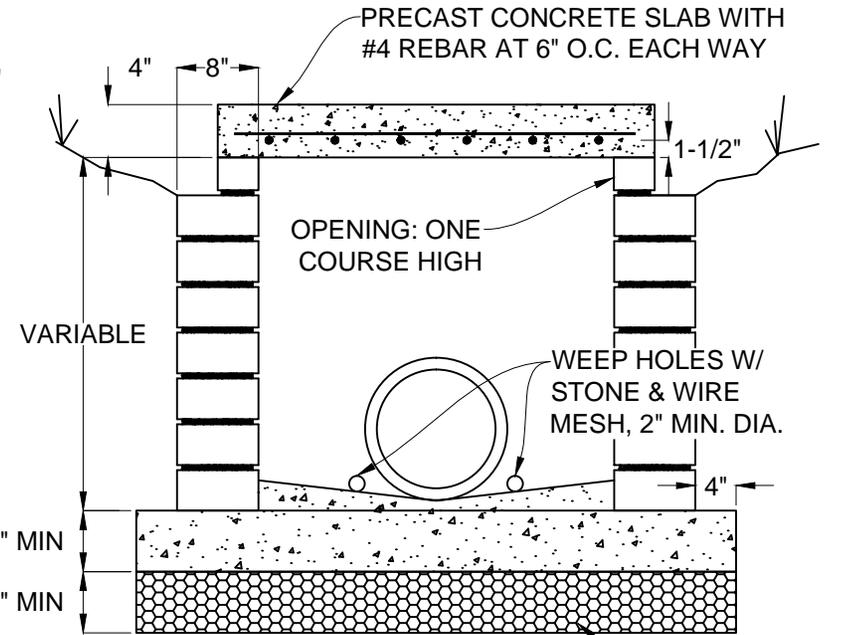

SECTION

STONE BEDDING

TOWN OF APEX
STANDARDS

EFFECTIVE: DECEMBER 18, 2012

YARD INLET W/ CONCRETE SLAB

STD. NO.

500.01

SHEET 1 OF 1