


NOTES:


1. REDUCED PRESSURE PRINCIPLE BACKFLOW PREVENTION ASSEMBLY SHALL COMPLY WITH ASSE 1013 & AWWA C511.
2. REDUCED PRESSURE DETECTOR BACKFLOW PREVENTION ASSEMBLY SHALL COMPLY WITH ASSE 1047. UNIT SHALL BE USED FOR ALL FIRE PREVENTION SYSTEMS WITH FDC, CHEMICAL, PROCESSED OR BOOSTERED.
3. DOUBLE CHECK VALVE BACKFLOW PREVENTION ASSEMBLY SHALL COMPLY WITH ASSE 1015 & AWWA C510.
4. DOUBLE CHECK DETECTOR BACKFLOW PREVENTION ASSEMBLY SHALL COMPLY WITH ASSE 1048.
5. BACKFLOW ASSEMBLY SHALL BE CENTERED ON CONCRETE PAD AND CENTERED WITHIN ENCLOSURE OR BASED ON MANUFACTURER SPECIFICATION.
6. ASSE 1060 CLASS 2 FREEZE-RETARDANT ENCLOSURE REQUIRED.
7. STANDARD 120V GFCI ELECTRICAL RECEPTACLE TO BE INSTALLED IN ACCORDANCE WITH THE NC ELECTRICAL CODE FOR OUTDOOR OPERATION.
8. PIPE MATERIAL SHALL BE CLASS 350 DIP AWWA C150 AND C151 APPROVED BY THE TOWN.
9. INSTALLATION SHALL BE IN COMPLIANCE WITH ALL APPLICABLE TOWN ORDINANCES, SPECIFICATIONS, UNIVERSITY OF SOUTHERN CALIFORNIA FOUNDATION FOR CROSS-CONNECTION CONTROL AND HYDRAULIC RESEARCH AND THE NC PLUMBING CODE.
10. PROPERTY OWNER SHALL BE RESPONSIBLE FOR MAINTENANCE AND OPERATION OF BACKFLOW PREVENTION ASSEMBLY AND COMPLIANCE WITH REPORTING AND TESTING REQUIREMENTS.

DOUBLE CHECK VALVE ASSEMBLY AND REDUCE PRESSURE ASSEMBLY (DOMESTIC)

DOUBLE CHECK DETECTOR BACKFLOW ASSEMBLY (FIRE)

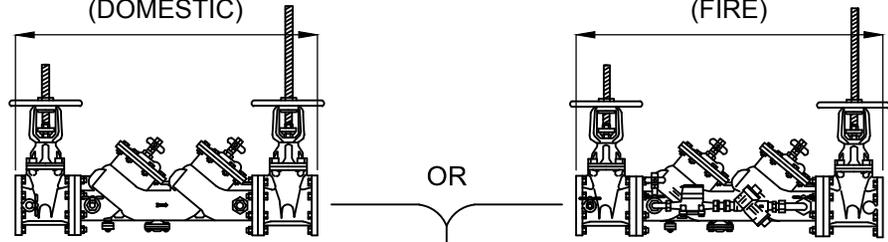

REDUCED PRESSURE DETECTOR BACKFLOW ASSEMBLY (FIRE)

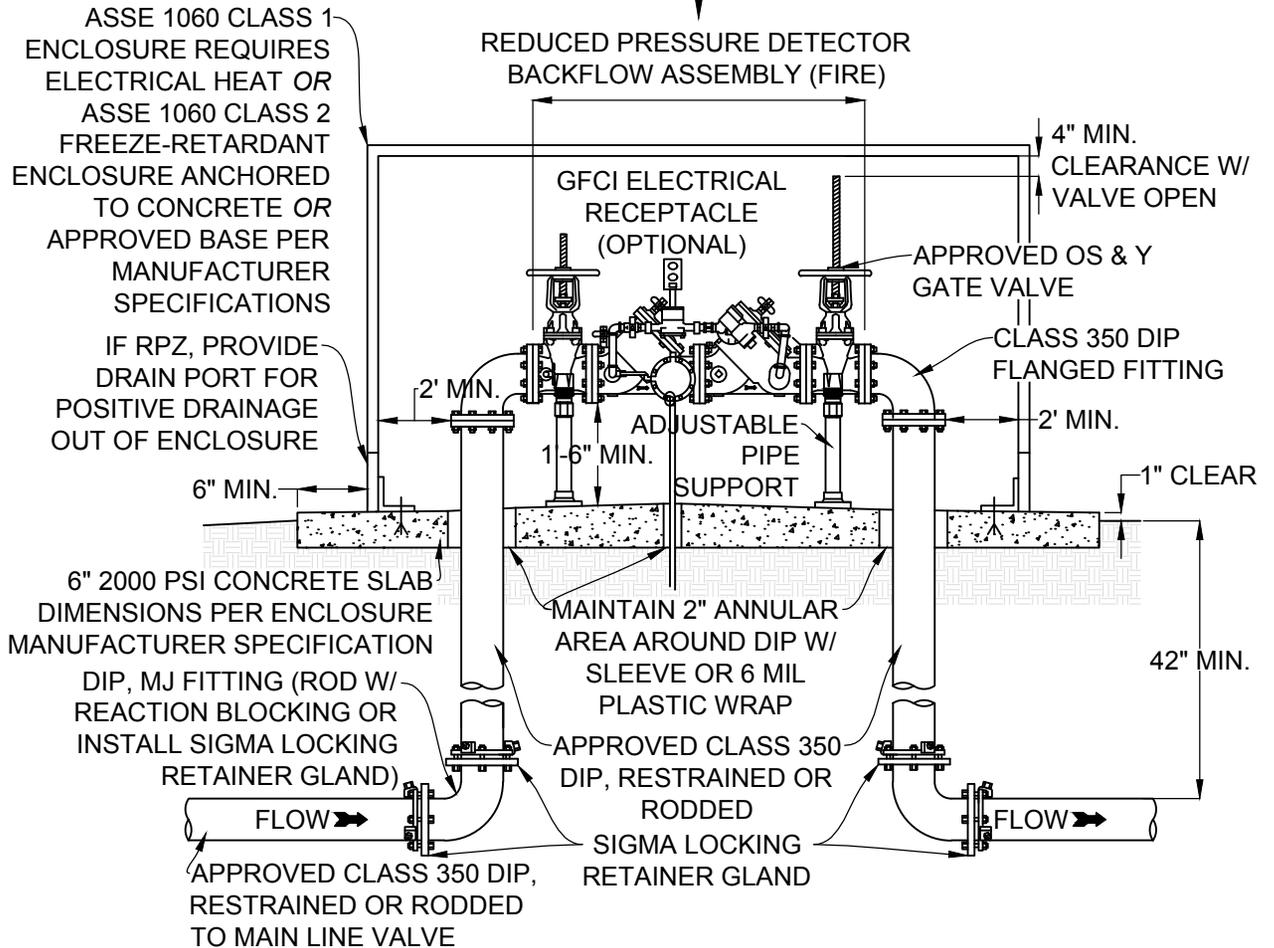

TOWN OF APEX
STANDARDS

COMMERCIAL OUTDOOR BACKFLOW ASSEMBLY
(3" DIAMETER & LARGER)

STD. NO.

620.06

SHEET 1 OF 1

EFFECTIVE: DECEMBER 21, 2010