


CLASS A BEDDING
 REQUIRED FOR DEPTHS ≤ 16 FEET

CLASS B BEDDING
 REQUIRED FOR DEPTHS > 16 FEET

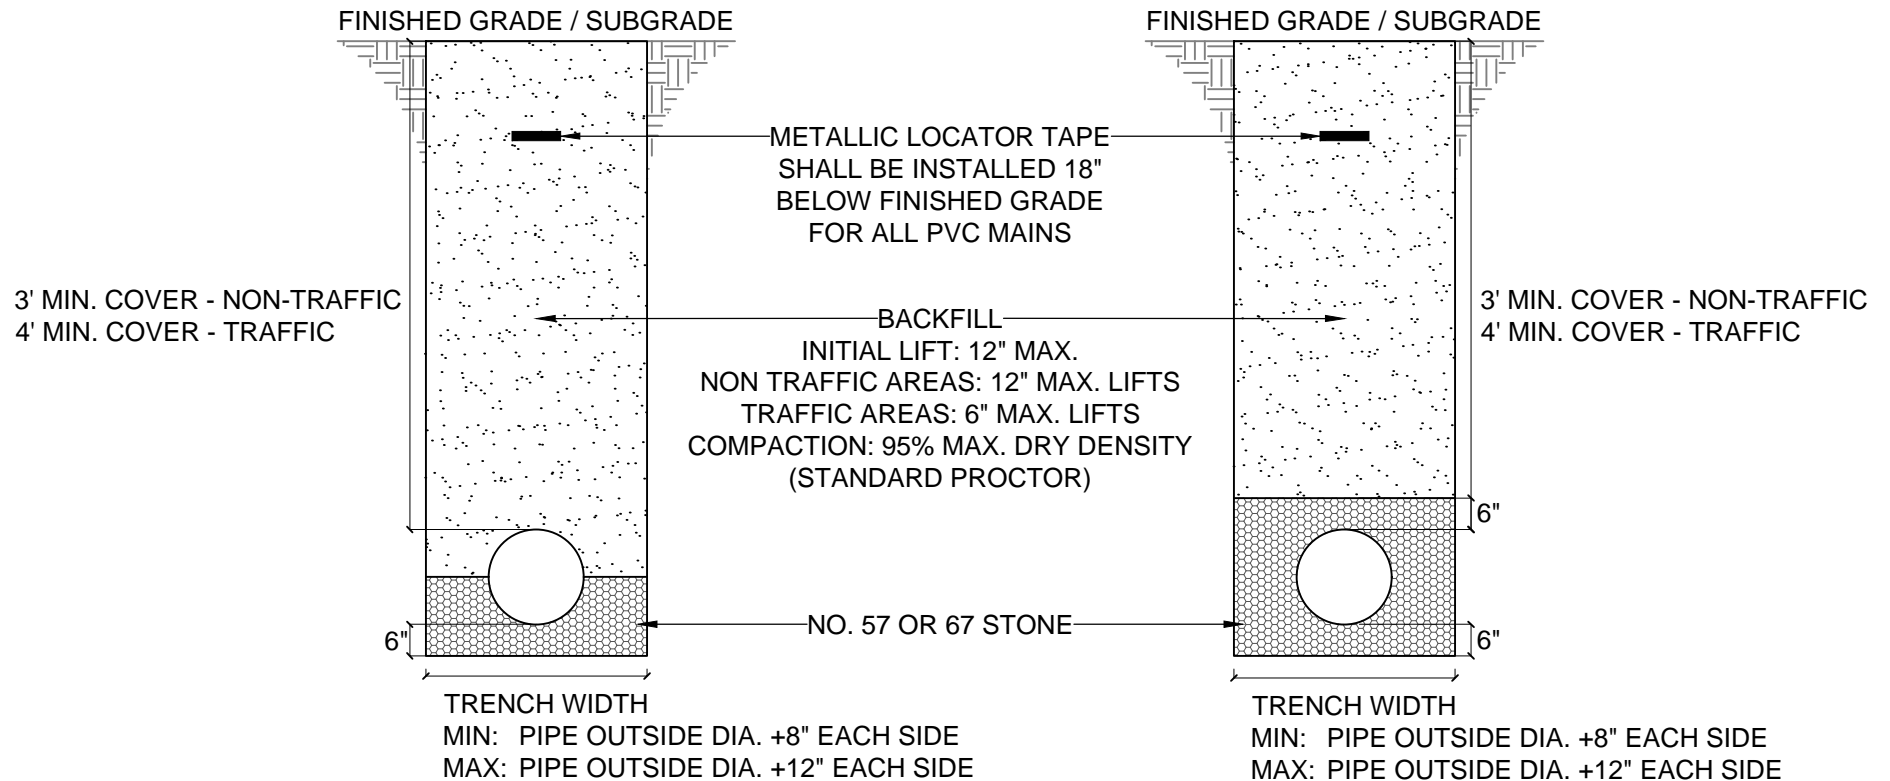

NOTES:

1. FOR TRENCHES REQUIRING SHORING & BRACING, DIMENSIONS SHALL BE TAKEN FROM THE INSIDE FACE OF THE SHORING & BRACING.
2. INSTALLATIONS > 13 FEET AND < 20 FEET DEPTH SHALL BE DIP OR C900 DR 18.

**TOWN OF APEX
 STANDARDS**

EFFECTIVE: JULY 21, 2015

SANITARY SEWER PIPE BEDDING & BACKFILLING

STD. NO.

700.01

SHEET 1 OF 1