

**NOTES:**


1. ALL PIPE AND FITTINGS SHALL BE OF A CONSISTENT MATERIAL THROUGHOUT THE ENTIRE SERVICE. EXCEPTION: STAND PIPE MAY TRANSITION TO SCH 40 PVC AT TOP OF WYE.
2. SERVICE SADDLES SHALL BE A ROMAC INDUSTRIES STYLE 'CB' OR EQUAL.

**DEPTH ≤ 16 FEET - CLASS "A" BEDDING**

- UNDERCUT TRENCH BOTTOM 6 INCHES MINIMUM BELOW PIPE
- FILL PIPE TO SPRING LINE WITH NO. 57 OR 67 STONE

**DEPTH > 16 FEET - CLASS "B" BEDDING**

- UNDERCUT TRENCH BOTTOM 6 INCHES MINIMUM BELOW PIPE
- FILL TO 6 INCHES ABOVE PIPE WITH NO. 57 OR 67 STONE

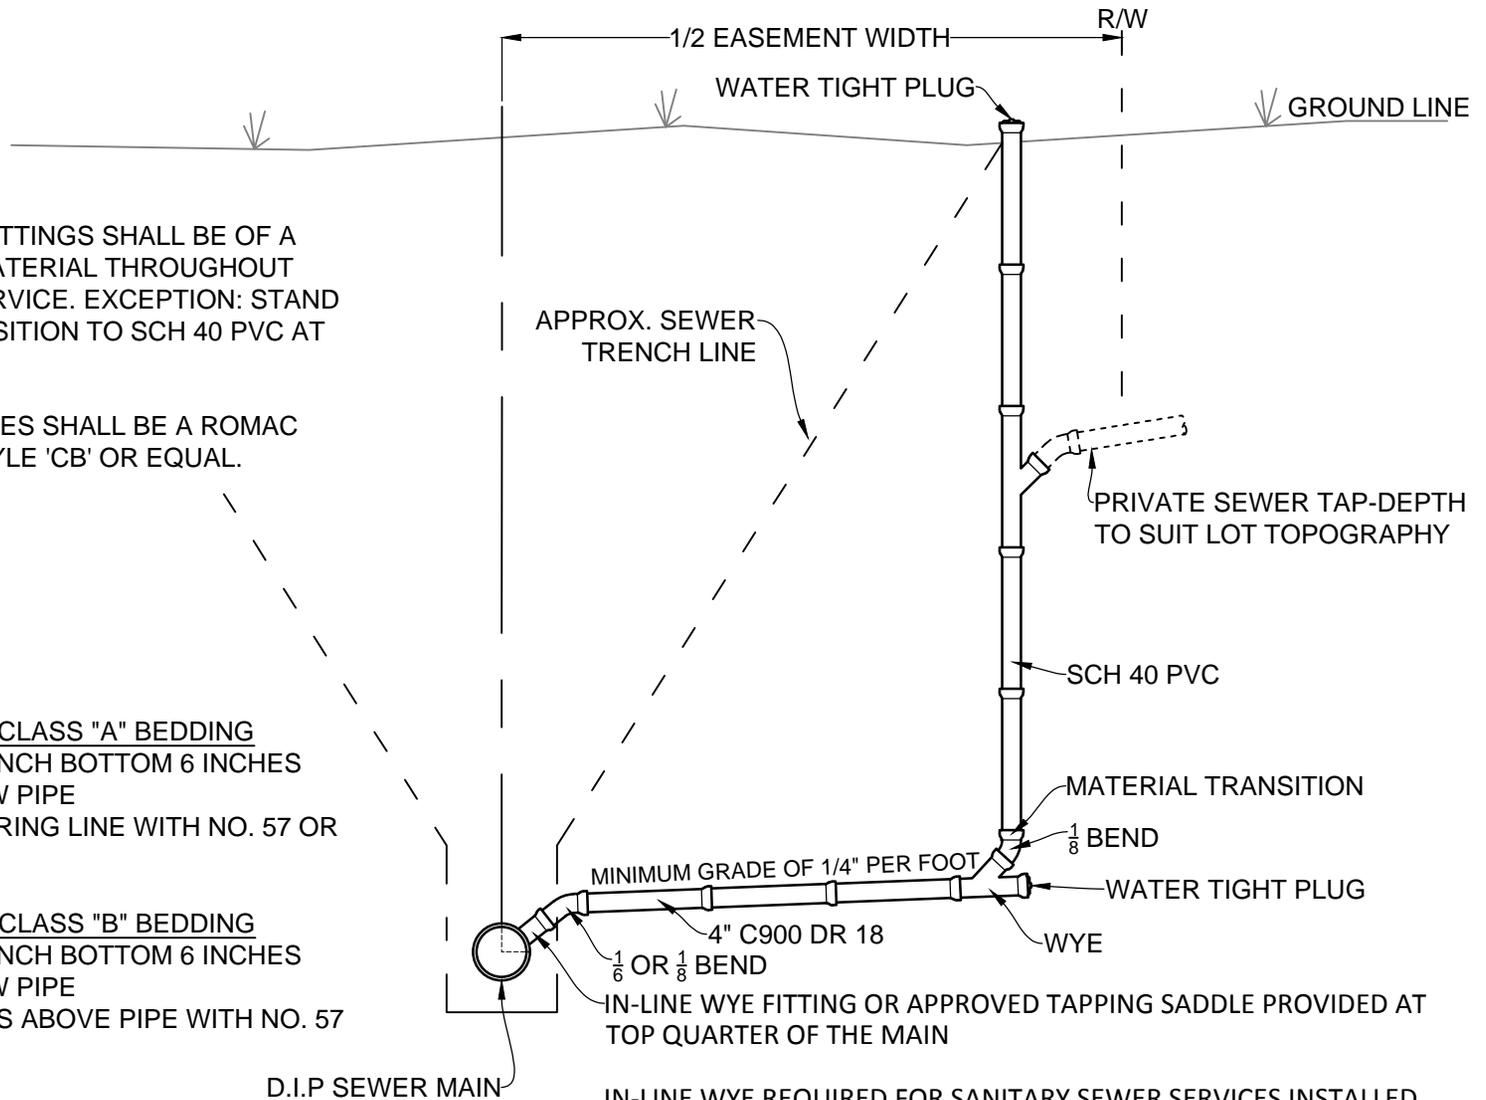

IN-LINE WYE REQUIRED FOR SANITARY SEWER SERVICES INSTALLED WITH NEW CONSTRUCTION WHEN PARCEL AND SERVICE LOCATIONS ARE KNOWN AND IDENTIFIED ON APPROVED PLANS

TOWN OF APEX  
STANDARDS

EFFECTIVE: JULY 21, 2015

**4" SANITARY SEWER TAP & SERVICE FOR  
SEWER MAINS OVER 13' DEEP**

STD. NO.

**700.10**

SHEET 1 OF 1