


TOWN OF APEX
SOLAR PANEL INTERCONNECTION
SINGLE LINE DIAGRAM FOR SYSTEM

NET METERING OPTION

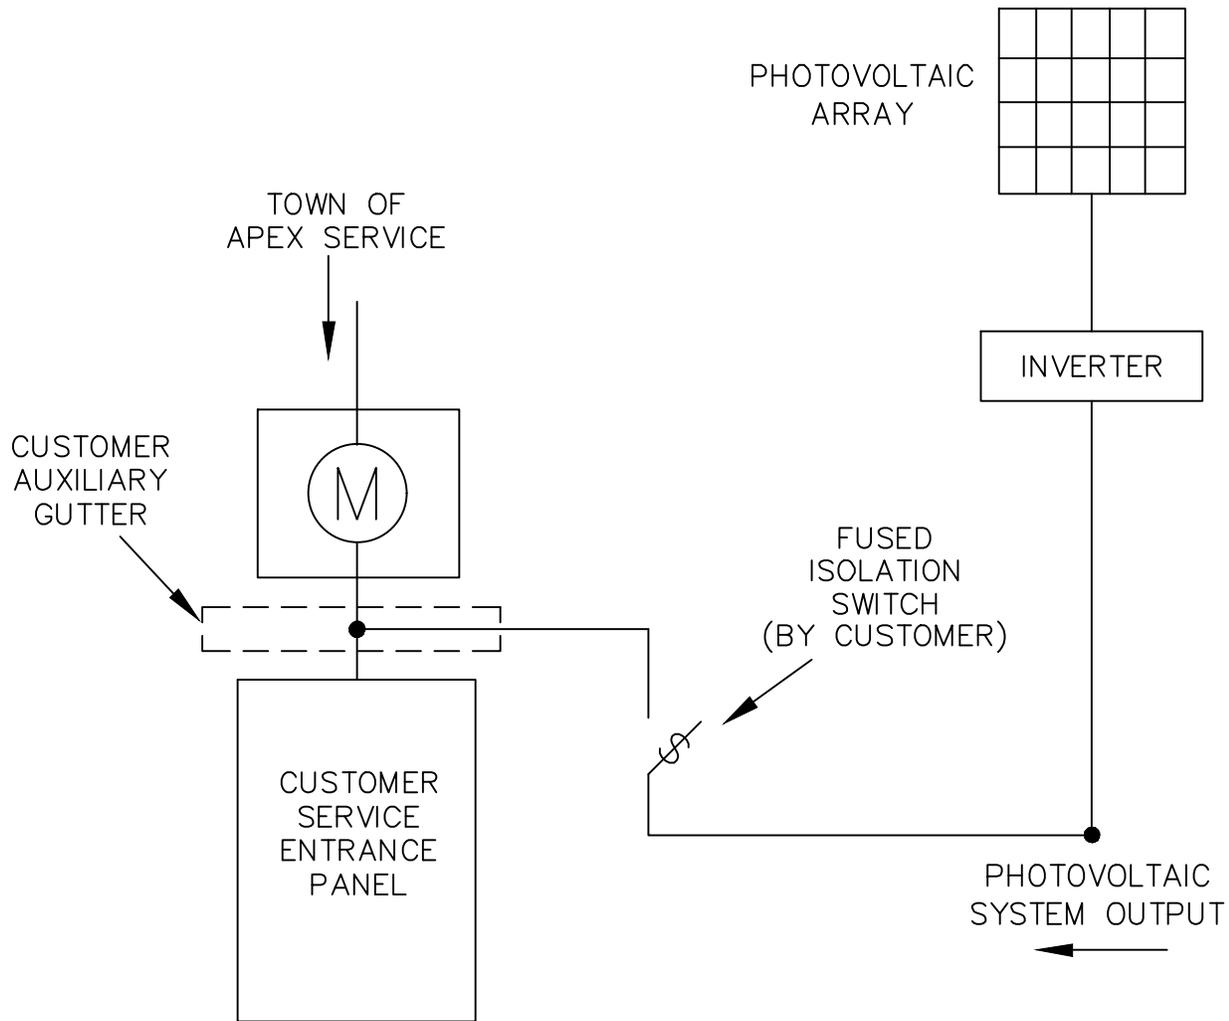

NOTES:

1. CONNECT TOWN SERVICE TO TOP LUGS IN METER BASE
2. METER FOR SERVICE.
3. INVERTER/ISOLATION SYSTEM TO BE UL 1741 LISTED AND INSTALLED IN ACCORDANCE WITH NATIONAL ELECTRICAL CODE. (NFPA 70)
4. ISOLATION SWITCH BY CUSTOMER TO BE SIZED PER NEC (NFPA 70).
5. LABEL CUSTOMER ISOLATION SWITCH PER NOTES IN ATTACHMENT #2.