



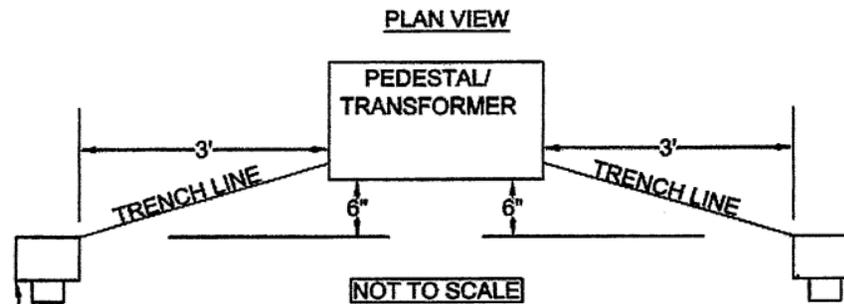

Temporary Power Board Location Requirements

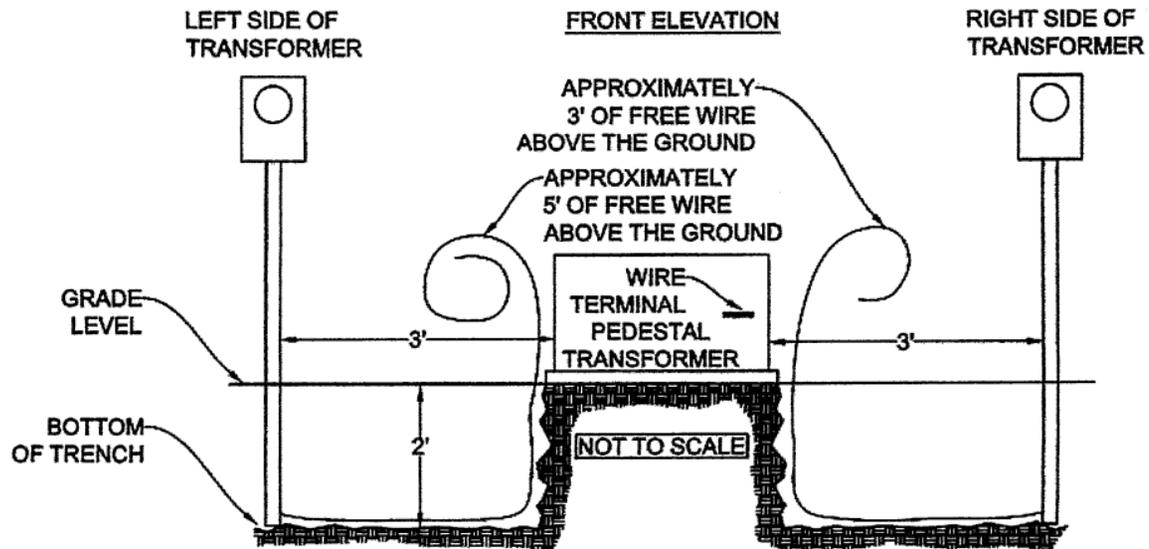

TEMPORARY BOARDS TO BE INSTALLED
APPROXIMATELY 6" FORWARD OF TRANSFORMER